



## AMENDMENT OF SOLICITATION/CONTRACT (AGREEMENT)

### SECTION I

Instructions to Offerors --- Amendment of Solicitation. The following instructions apply unless specified otherwise in an AAFES letter accompanying this amendment.

a. Offerors must acknowledge receipt of this amendment prior to the hour and date specified for receipt of proposals in the original solicitation, or the hour and date specified in this amendment if such has been amended. Offeror must acknowledge by one of the following means:

(1) By signing and returning all except one copy of this amendment;

(2) By acknowledging receipt of this amendment on each copy of the proposal submitted;

(3) By separate letter or telegram which includes a reference to the solicitation and amendment number.

b. Proposals must be based upon and refer to the solicitation as amended. Unless an acknowledgment of this amendment is received by the Contracting Officer before the hour and date specified for receipt of proposals, Offeror=s proposal may be considered nonresponsive.

c. If you desire to revise a proposal previously submitted, such revision must be received prior to the hour and date specified for receipt of proposals inclosed in a sealed envelope addressed to the issuing office, with the name and address of offeror and the solicitation number on the face of the envelope. Telegraphic proposals will not be considered unless authorized by the solicitation; however, proposals may be modified by telegraphic notice provided such notice is received prior to the time set for receipt of proposals. Telegraphic modifications should not reveal the amount of the original or of the revised proposal.

### SECTION II

Instructions to Contractor --- Amendment of Contract.

Unless otherwise instructed, all except one copy of this Amendment are to be executed by a person authorized to bind the firm contractually and returned to the Contracting Officer. The effective date will be the date the amendment is signed in block 6 by the Contracting Officer or the date(s) indicated in block 4, whichever is later.

Solicitation #AAFES-REZC-04-005-09-039

Attachment #1 to Amendment #1

Page 1 of 1

QUESTION - Are the new faucets for the existing kitchen sinks furnished by AAFES or the contractor?

ANSWER: *The Contractor is to furnish and install all Items except as otherwise noted; Sheet A6.0 Equipment Schedule, Item BK61A, existing 3 Compartment Sink, "Replace all Faucets": the Schedule does not reflect AAFES to Furnish nor the Contractor to install; therefore the Contractor shall furnish and install. Attached are the Cut Sheets. (Inclosure #1 consisting of 2 pages).*



**T&S BRASS AND BRONZE WORKS, INC.**  
 2 SADDLEBACK COVE / P.O. BOX 1088 / TRAVELERS REST, SC 29690  
 PHONE 800-476-4103 - FAX 864- 834-3518



Model No.


B-0133-BC

**RELIABILITY  
 BUILT IN**

Job Name:

Architect/Engineer Approval:


Notes:

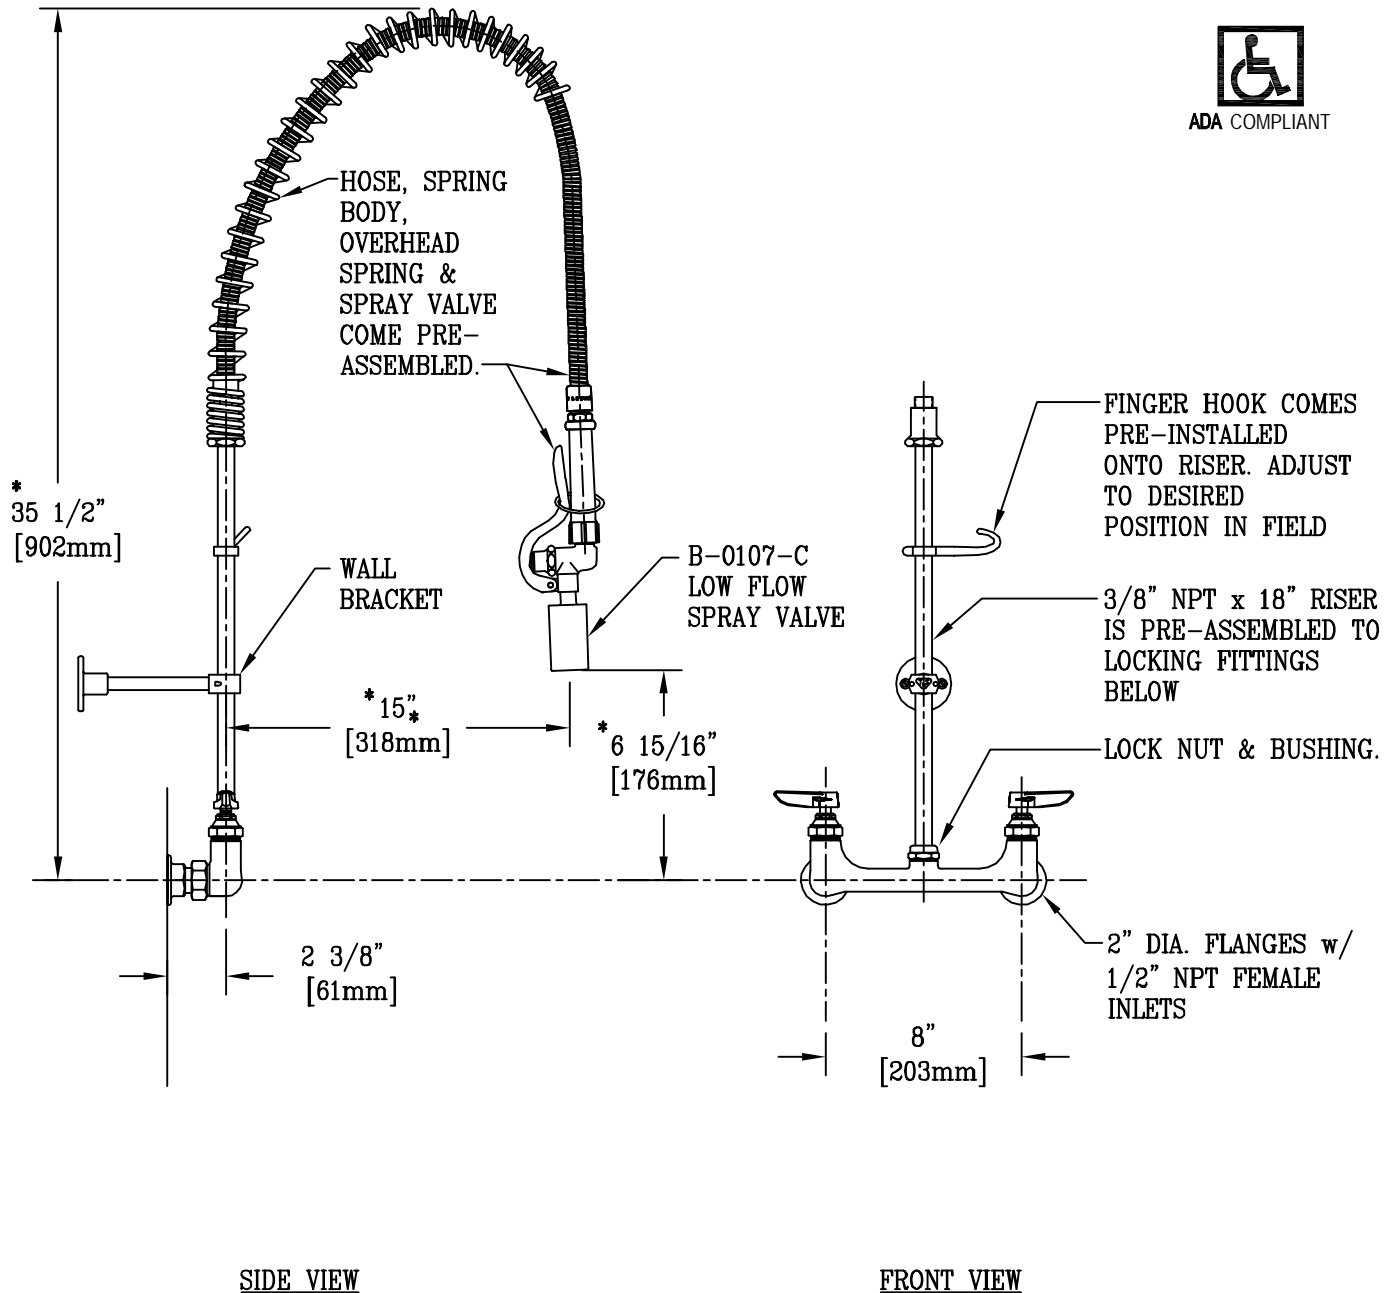

\* DIMENSIONS MAY VARY ± 1/2" ON EACH INSTALLATION

Product Description:  
 EASY INSTALL PRE-RINSE UNIT:  
 8" c/c WALL MOUNT BASE MIXING FAUCET, 1/2" NPT FEMALE INLETS,  
 18" RISER, SUPPORT SPRING, 44" FLEX HOSE, B-0107-C SPRAY VALVE, WALL BRACKET

Drawn: WJS	Checked LEL	Scale: 1 : 8
Approved M/VW	Date: 12-9-03	



T&S BRASS AND BRONZE WORKS, INC.

2 SADDLEBACK COVE / P.O. BOX 1088 / TRAVELERS REST, SC 29690

PHONE 800-476-4103

FAX 864- 834-3518



REG.#A2601  
ISO #9002

Model No.


B-0156

Item No.:

Job Name:

Architect/Engineer Approval:

Notes:

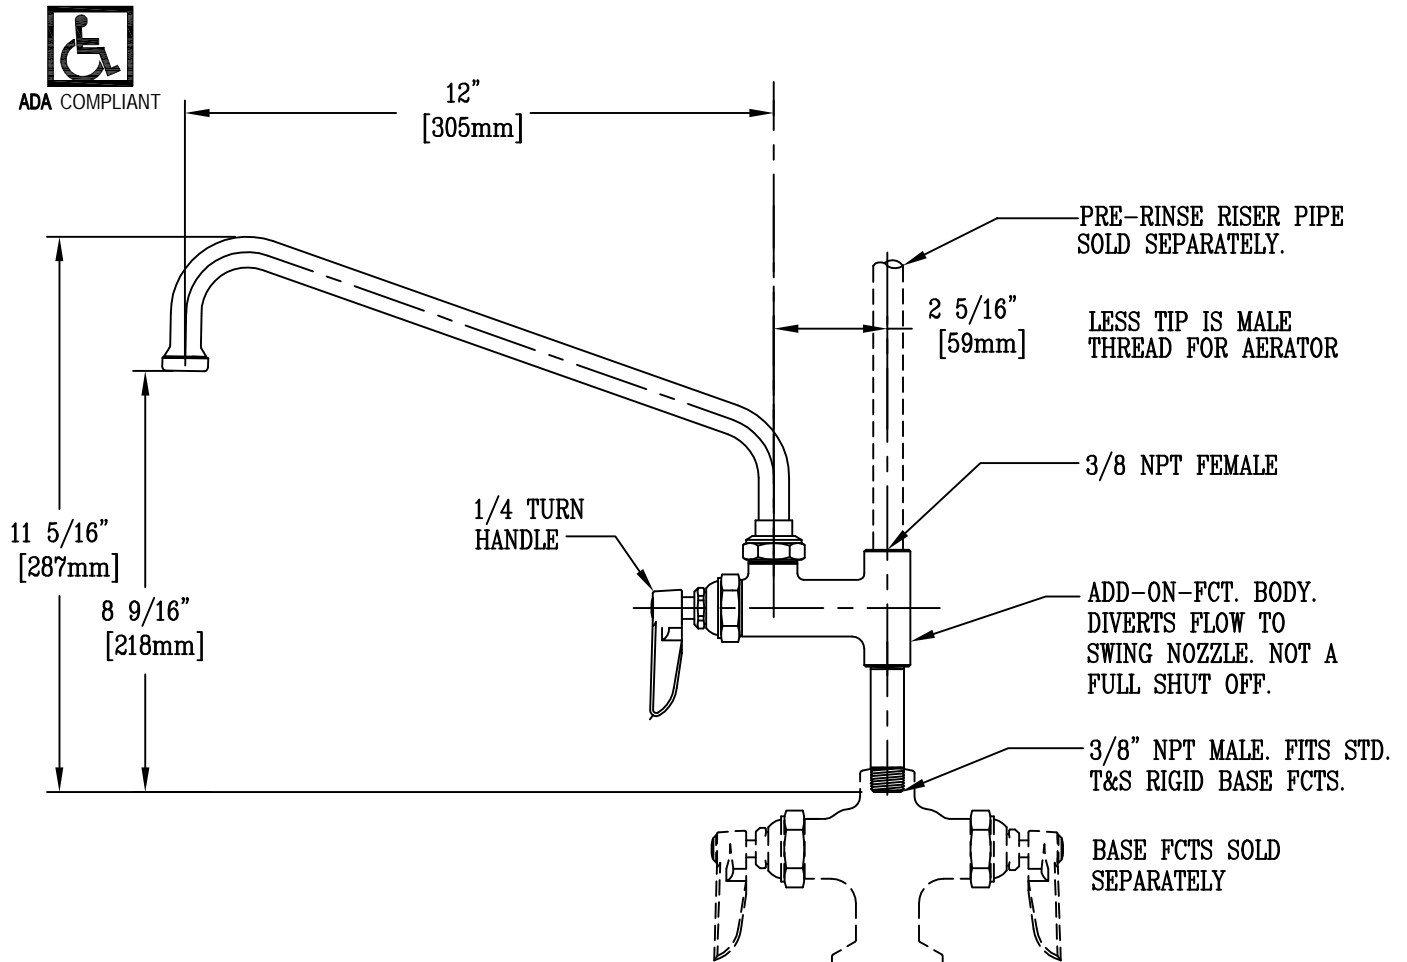

**NOTES:** 1. THE ADD-ON FAUCET IS AN ADDITION TO PRE-RINSE UNITS AND IS INSTALLED IN OUTLETS OF BASE MIXING FAUCETS OF UNITS BEFORE FITTING RISER PIPE, AS SHOWN.

2. LEVER HANDLE CONTROLS WATER ON-OFF THRU NOZZLE ONLY; PRESSURE IS ALWAYS "ON" IN RISER PIPE. (CONTROLLED BY BASE FAUCET).

Product Description:

ADD-ON FAUCET WITH 12" SWING NOZZLE AND 1/4 TURN HANDLE

Drawn:

WJS

Checked

JKD

Scale:

1 : 4

Approved

MVW

Date:

8/18/99